

SCHEMA SINOPTICA A BAZINULUI HIDROGRAFIC CRISUL REPEDE REGULI DE EXPLOATARE PE TIMP DE APE MARI

S.G.A. BIHOR
Jud. Bihor

S.G.A. CLUJ
Jud. Cluj


- 1. BULZ
- 2. BRATCA
- 3. BOROD
- 4. SUNCUIUS
- 5. VADU CRISULUI
- 6. AUSEU
- 7. ASTILEU
- 8. ALESD

- 9. LUGASU DE JOS
- 10. TILEAGD
- 11. SACADAT
- 12. INEU
- 13. OSORHEI
- 14. COPACEL
- 15. HIDISELUL DE SUS
- 16. ORADEA

- 17. SANTANDREI
- 18. BORS
- 19. GIRISU DE CRIS
- 20. NOJORID
- 21. SANNICOLAU ROMAN
- 22. GEPIU
- 23. CEFA

- 1. IZVORUL CRISULUI
- 6. SACUIEU
- 2. SANCRAIU
- 7. POIENI
- 3. CALATELE
- 8. CIUCEA
- 4. HUEDIN
- 9. NEGRENI
- 5. MARGAU

Debite maxime admise in sectiunile:		
Raul	Sectiunea	Debit max (mc/s)
Crisul Repede	Ciucea	350.0
Crisul Repede	Vadu Crisului	400.0
Crisul Repede	Oradea	400.0

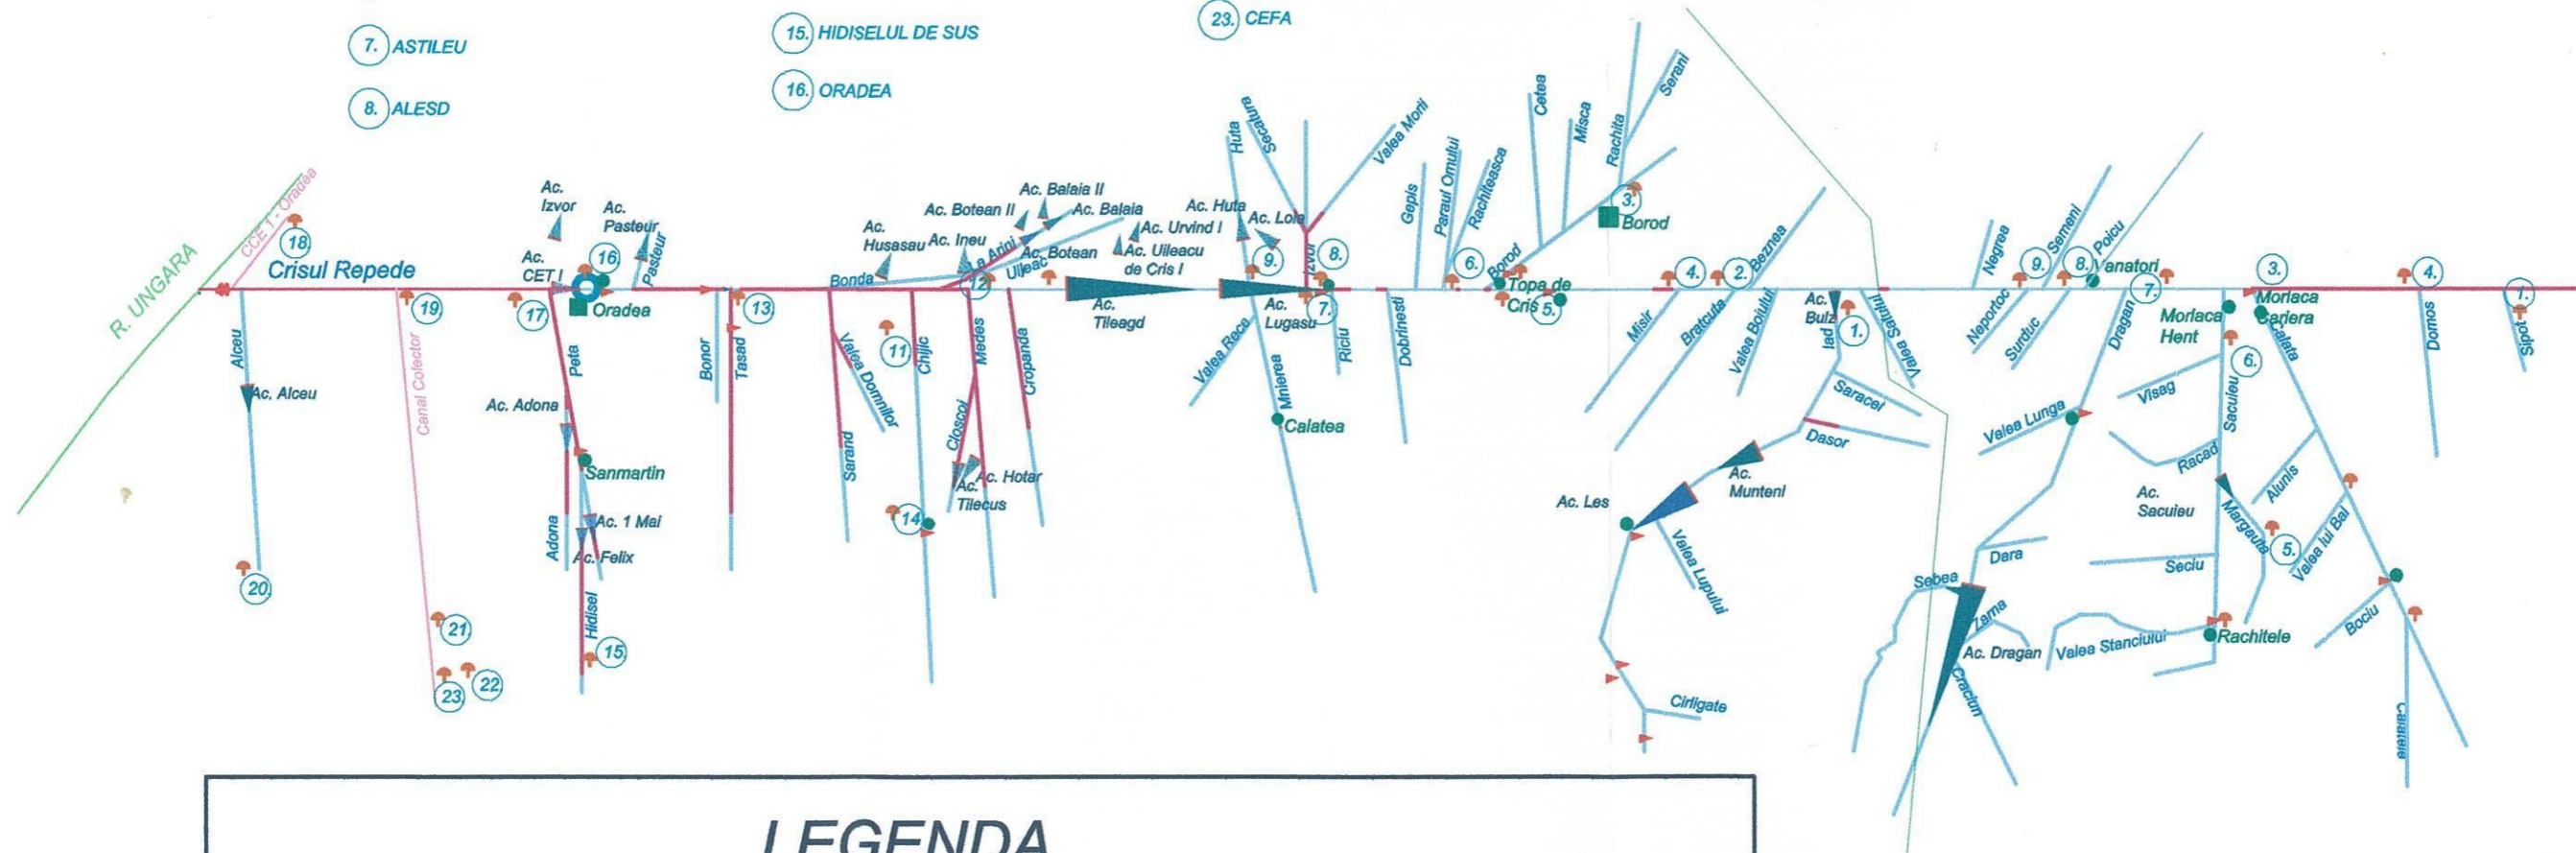

LEGENDA

- | | |
|---|--|
| <ul style="list-style-type: none"> ○ Localitate ♦ Statie de pompare ▶ Post hidrometric ● Post pluviometric ↑ Sirena ■ Statie Meteo | <ul style="list-style-type: none"> ▲ Acumulare permanenta ▴ Acumulare nepermanenta ▲ Acumulare terti — Cursuri — Canale — Granita de Stat — Limite judet — Indiguiri |
|---|--|

Regulament Romania Ungaria
Ciucea
Oradea